


# Field wiring

Figure 15: Typical field wiring (air handler/electrical heat) (single-phase)

**ALL FIELD WIRING TO BE IN ACCORDANCE WITH ELECTRIC CODE (NEC) AND/OR LOCAL CODES**

— — — POWER WIRING  
- - - CONTROL WIRING  
———— FACTORY WIRING

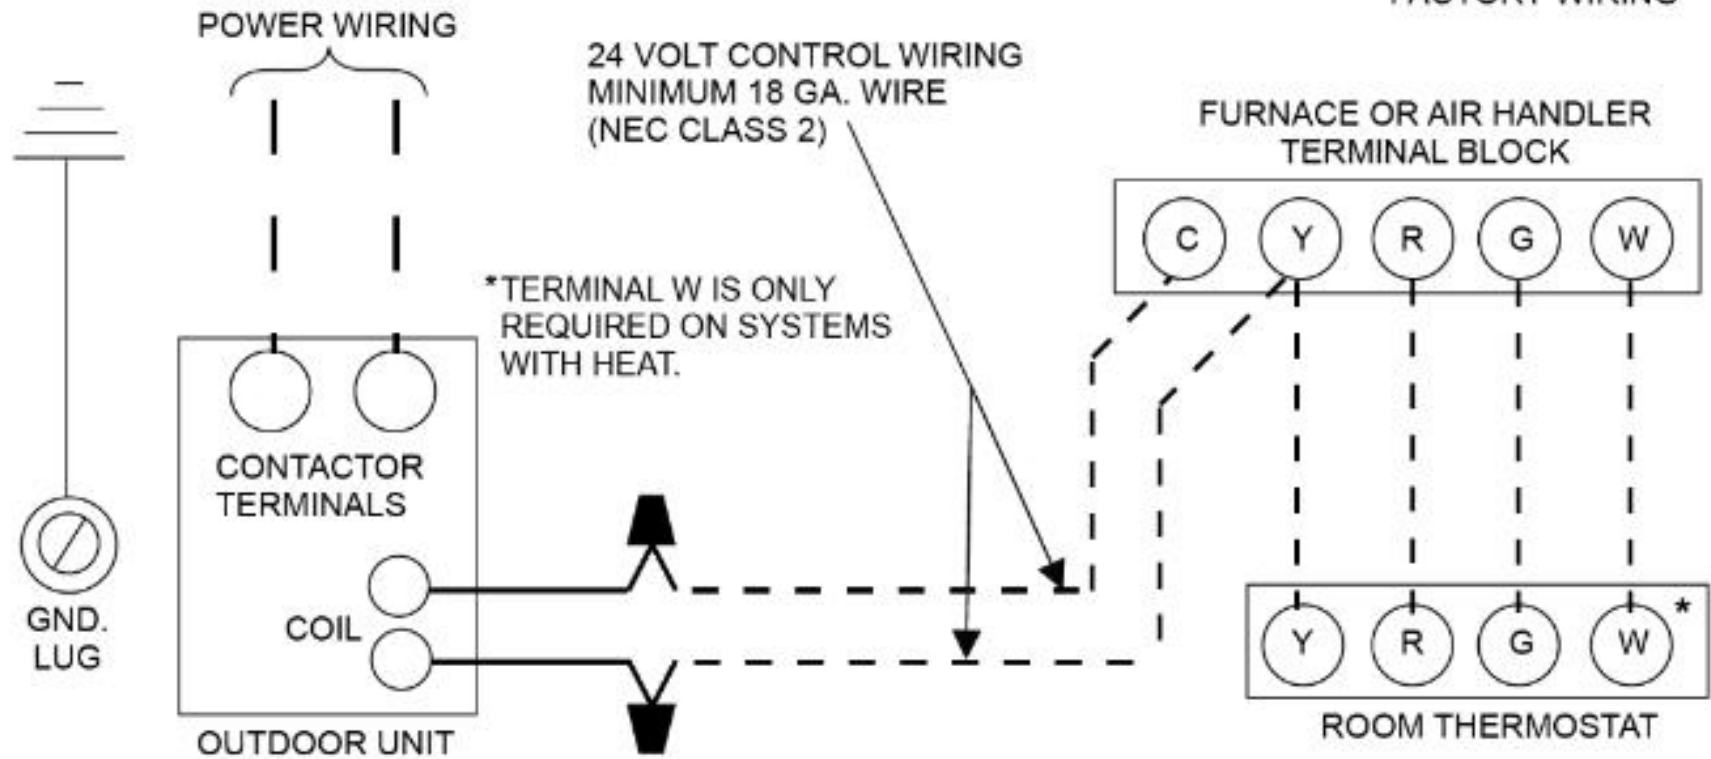

**ALL OUTDOOR WIRING MUST BE WEATHERPROOF. USE COPPER CONDUCTORS ONLY.**